



Double Pole Double Switch PTE and Fire Switch Wiring Schematic

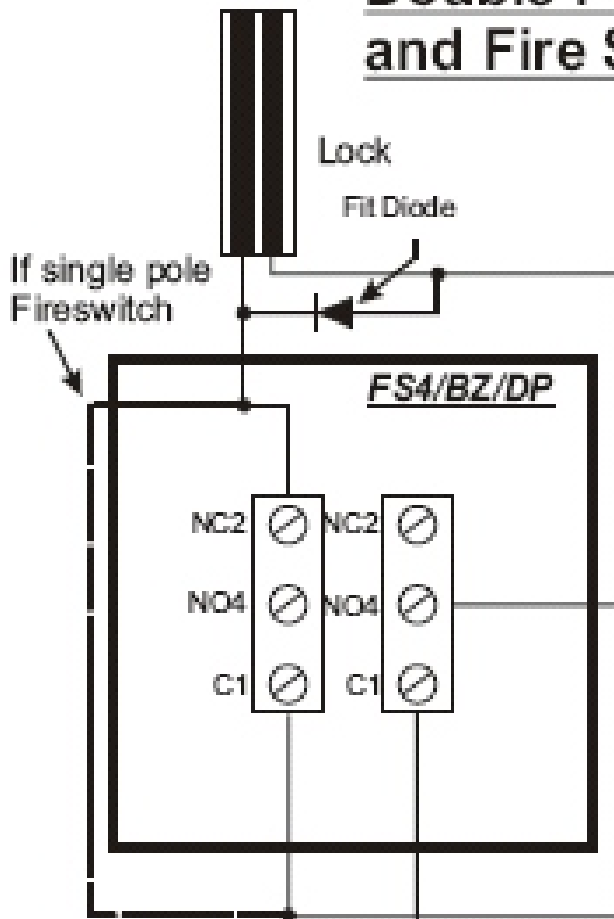

Notes
 A = Switched Negative from controller
 Use 1.5mm flex or Singles (Stranded)
 B = To system Push to Exit
 Use CW1308
 C = To system common (0v).
 Use CW1308
 D = To Lock +12v Supply.
 Use 1.5mm Flex or Singles (Stranded)

Replacement Parts for EPTE/PTE/DP/BZ
Security Screws
 PCON 43688
Security Screw Bits
 OEM 43687
 Please contact sales for replacements

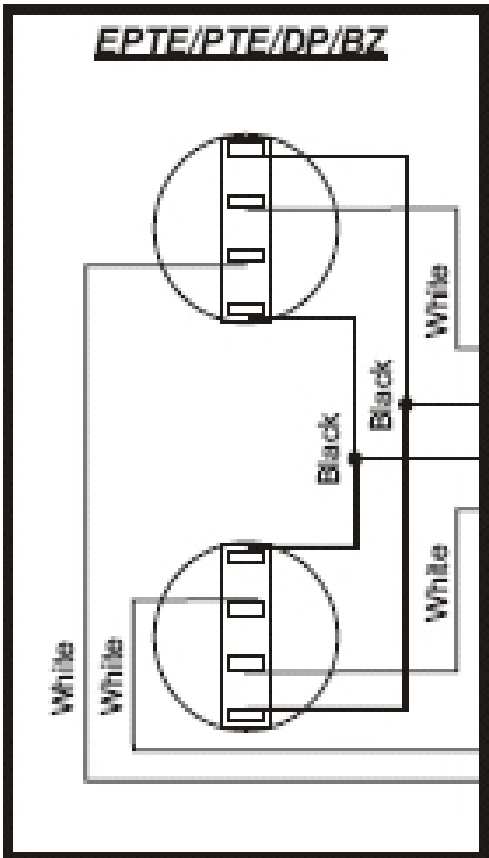

A & D are the Normally Closed contacts and break the Lock Power
 B & C are the Normally Open contacts and Trigger the door open timers

See Notes

Connection Table

	RDC	RDC/DE	Vertex
A	PL6/2	PL13/2	PL2/22
B	PL6/7	PL13/7	PL2/13
C	PL6/8	PL13/8	PL2/16
D	PL6/1	PL13/1	PL2/2

V.A.Turner
 29/06/06